


Applicable Tariffs	
General (domestic & Commercial)	YES
Comfort Heating	NO
Economy 7 (Load Switching)	NO
Economy 7 (Rate Switching)	YES
Economy 20	NO
Economy 20+	NO

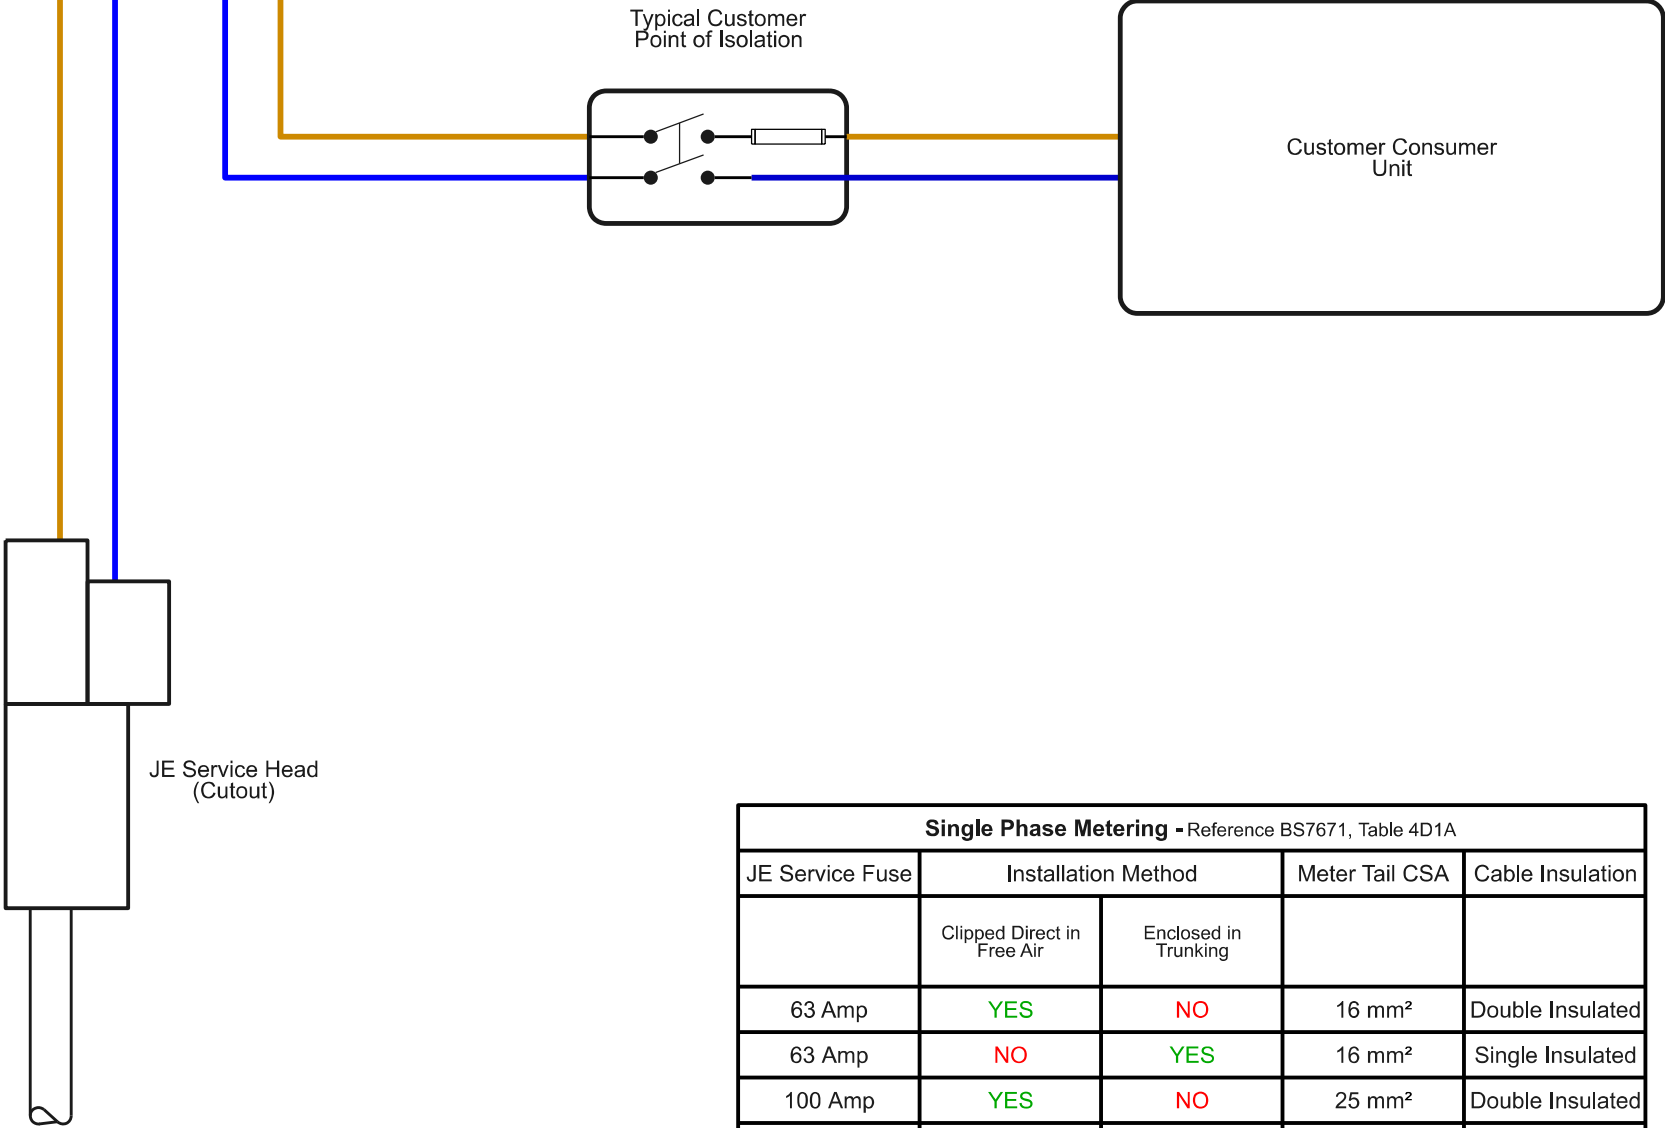

Single Phase Metering - Reference BS7671, Table 4D1A				
JE Service Fuse	Installation Method		Meter Tail CSA	Cable Insulation
	Clipped Direct in Free Air	Enclosed in Trunking		
63 Amp	YES	NO	16 mm²	Double Insulated
63 Amp	NO	YES	16 mm²	Single Insulated
100 Amp	YES	NO	25 mm²	Double Insulated
100 Amp	NO	YES	25 mm²	Single Insulated

C	03-09-2025	Mods as per MUP	TSB	CM
B	20-08-2019	Table and new liberty added	TSB	MV
A	05-11-2012	Table added and modifications	TSB	MV
-	20-08-2012	Original Issue	TSB	MV
Rev	Date	Description	Drn	Appd

Notes

- If the consumer units are visible and within 3m of JE Equipment, no additional point of isolation is required before the consumer unit(s) main switch.
- Additional point of isolation, where required, can be a main linked switch, linked circuit-breaker, or linked switch-fuse. Both line and neutral conductors need to be switched.
- Earthing not depicted.
- All meter tails are to be provided by the relevant contractor.

Title

Typical Arrangement for Single Phase, Single Element Meter Installation

The Intellectual Property Rights (IPR) ie. Patents, Copyright, Trade Secrets, Design Rights etc., remain strictly the property of 'Jersey Electricity Company plc' and may not be copied and /or reproduced in any form without their 'Express Permission'.



The Powerhouse PO Box 45 Queen's Road St. Helier Jersey JE4 8NY
Tel – 01534 505460 Fax – 01534 505565 e-mail – jec@jec.co.uk

Drg. No.

484-N21

Revision

C